3588
#11 225KVA
120/208
Loop L

#11
TAP CHANGER
FOR DE-ENERGIZED OPERATION ONLY
5
1
2
H1A
H1B
H2A
H2B
H3A
H3B

X1
X3
HOXO
X2

#11

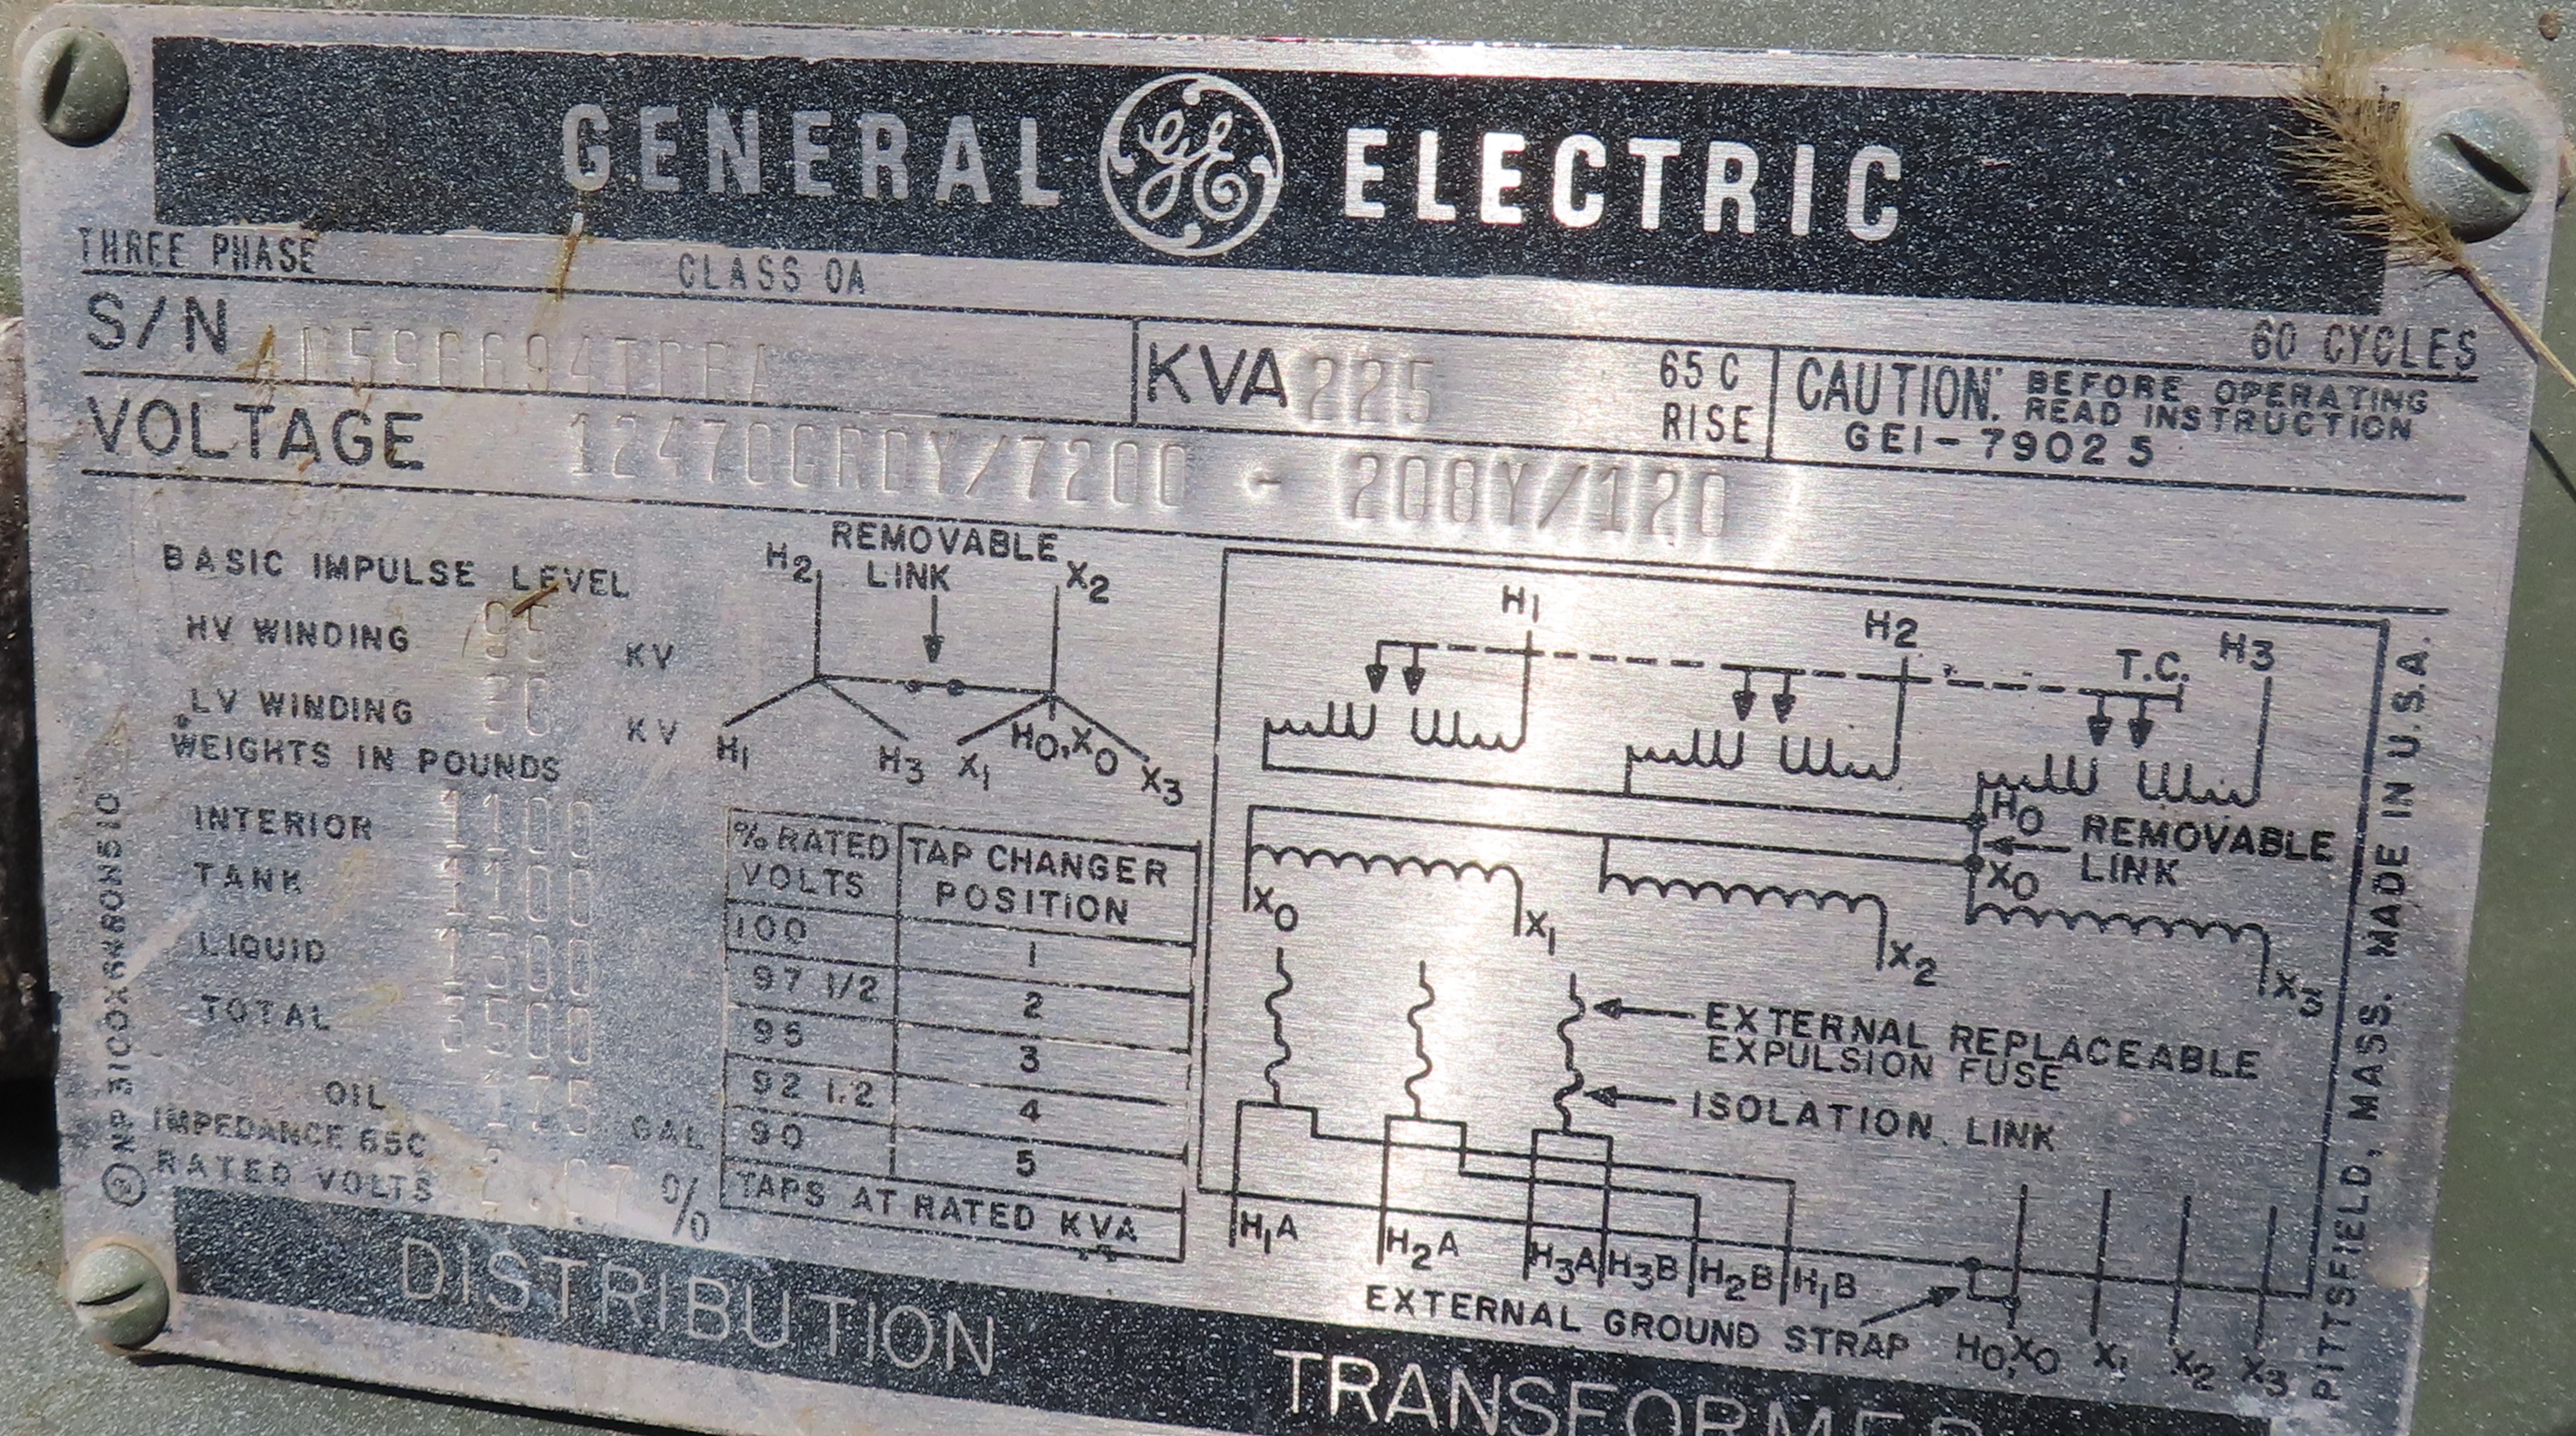

GENERAL ELECTRIC

THREE PHASE CLASS OA

S/N AN596694TCBA

KVA 225 65 C RISE

60 CYCLES

CAUTION: BEFORE OPERATING READ INSTRUCTION GEI-79025

VOLTAGE 12470GRDY/7200 - 208Y/120

BASIC IMPULSE LEVEL
HV WINDING 95 KV
LV WINDING 30 KV

WEIGHTS IN POUNDS

INTERIOR	1100
TANK	1100
LIQUID	1300
TOTAL	3500

OIL 175 GAL
IMPEDANCE 65C RATED VOLTS 2.07 %

% RATED VOLTS	TAP CHANGER POSITION
100	1
97 1/2	2
95	3
92 1/2	4
90	5

TAPS AT RATED KVA

REMOVABLE LINK
H2
X2
H1
H3
X1
H0, X0
X3
H1
H2
T.C.
H3
H0
X0
REMOVABLE LINK
X0
X1
X2
X3
EXTERNAL REPLACEABLE EXPULSION FUSE
ISOLATION LINK
H1A
H2A
H3A
H3B
H2B
H1B
EXTERNAL GROUND STRAP
H0X0
X1
X2
X3

NP 31C0X680510

PITTSFIELD, MASS. MADE IN U.S.A.

DISTRIBUTION TRANSFORMER